
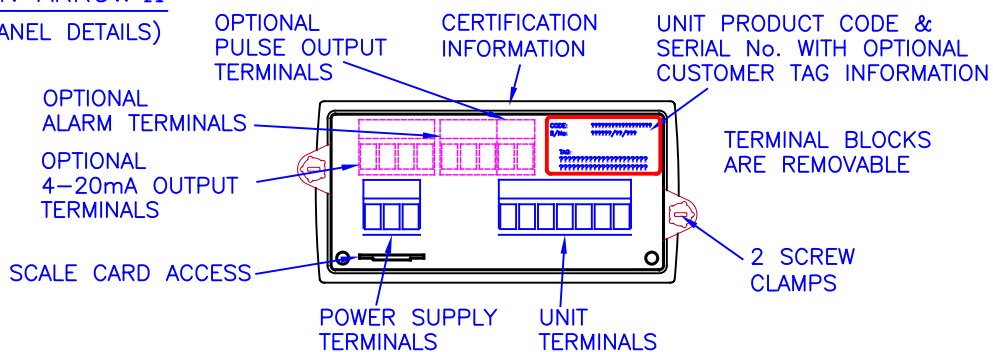
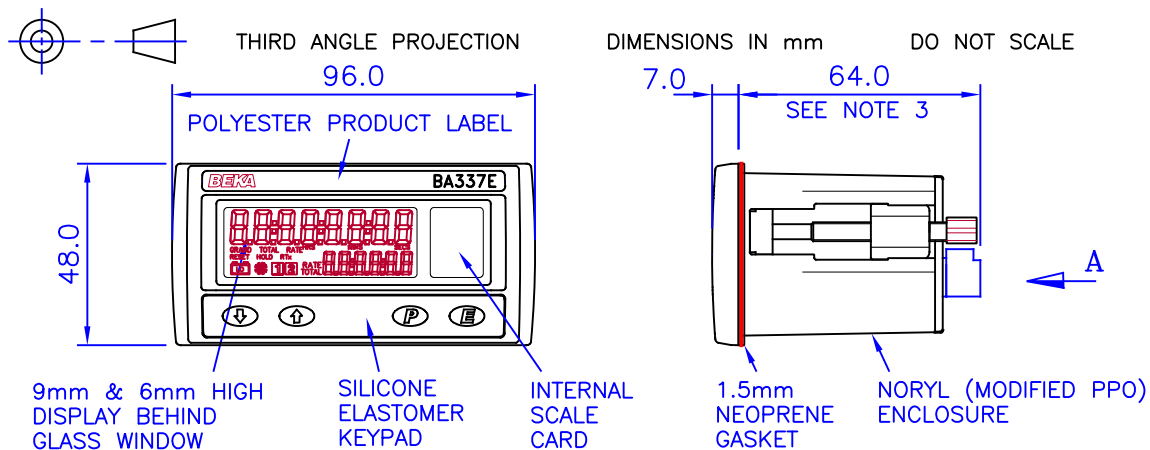


Iss.	Date	Modification	Ckd.	Appd.
1	23.05 2017	.		




BEKA associates
Hitchin
England
company confidential, copyright reserved.


Iss.	Date	Modification	Ckd.	Appd.



TERMINAL CONNECTIONS:

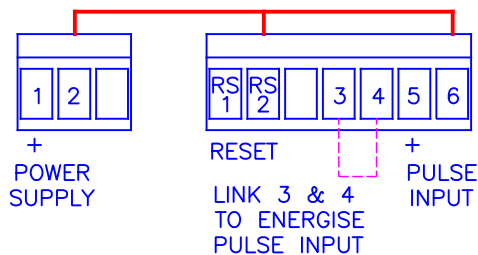

OPTION TERMINALS (WHEN OPTION FITTED):

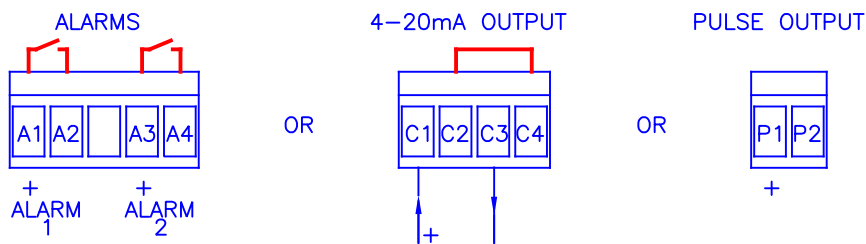

INSTALLATION:

- 1 INSERT UNIT INTO PANEL CUTOUT FROM FRONT.
- 2 SCREW CLAMPS ARE CLIPPED TO THE INDICATOR
& TIGHTENED FROM REAR OF PANEL.
RECOMMENDED TORQUE 22cNm MAX.
- 3 FOR PANELS GREATER THAN 3mm THICK ADD
ADDITIONAL DEPTH FOR CLAMPS.
(ie ADD PANEL THICKNESS LESS 3mm)

PANEL CUTOUT:

ANEL CUTOOT:

DIN 43 700: $92^{+0.8}_{-0} \times 45^{+0.6}_{-0}$

FOR IP66: $90^{+0.5}_{-0} \times 43.5^{+0.5}_{-0}$

Title	CUSTOMER DRAWING for BA337E 1 INPUT RATE TOTALISER IN PANEL MOUNTING ENCLOSURE	Drawn	Checked	Scale
		RC	.	NTS
		Drawing No. CD337E		