



Iss.	1	Date		Modification		Ckd.		Appd.	
Iss.		Date		Modification		Ckd.		Appd.	



THIRD ANGLE PROJECTION


DIMENSIONS IN mm

DO NOT SCALE

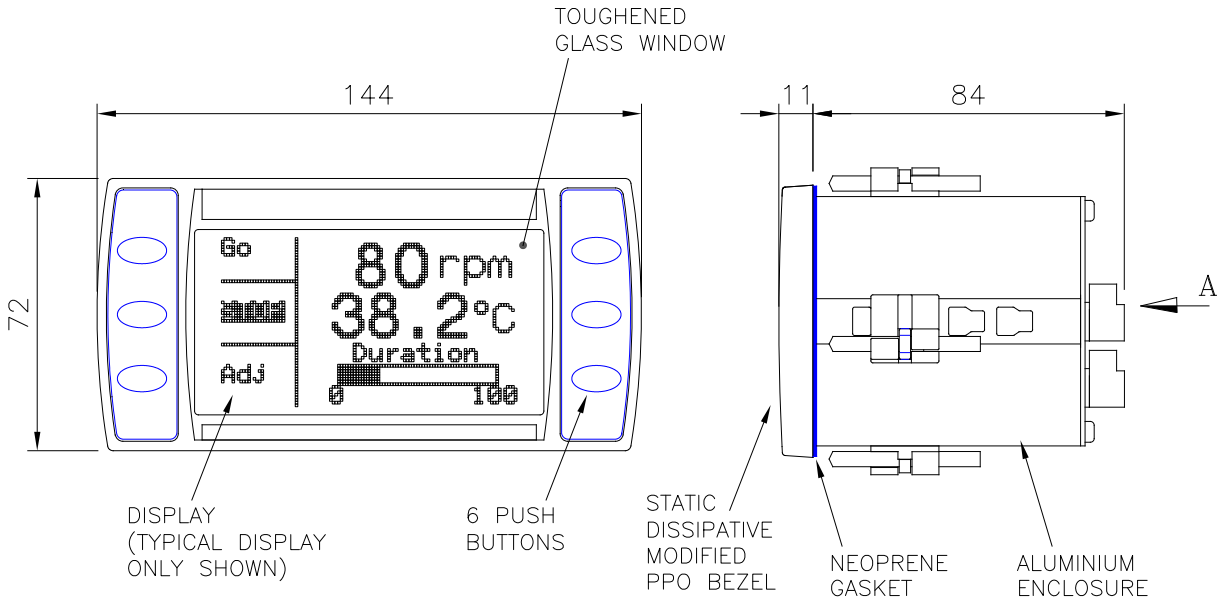


CERTIFICATION INFORMATION

VIEW ON ARROW A
(REAR PANEL DETAILS)

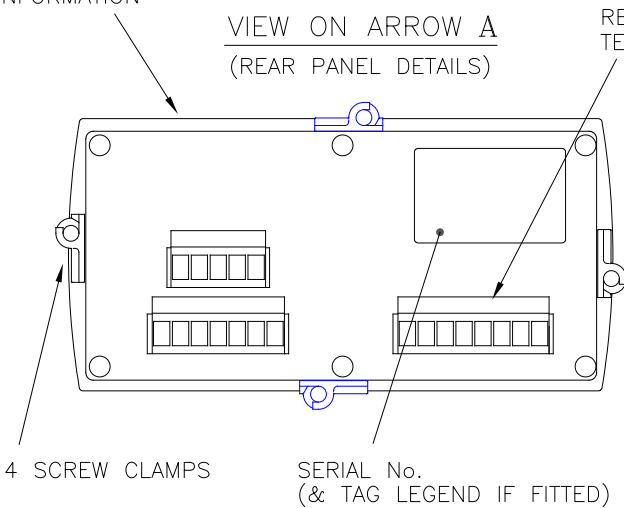


TERMINAL CONNECTIONS:

SWITCH OUTPUTS




TERMINALS 1 & 3 ARE INTERNALLY LINKED

UNIT TERMINALS



CONNECTIONS FOR OPTIONAL EXTERNAL SWITCHES



LINK SUBJECT TO USAGE

INSTALLATION:

- 1 INSERT UNIT INTO PANEL CUTOUT FROM FRONT.
- 2 SCREW CLAMPS ARE CLIPPED TO THE TEXT DISPLAY & TIGHTENED FROM REAR OF PANEL.
- 3 MAXIMUM RECOMMENDED TIGHTENING TORQUE 22cNm (1.95lbf.in)

PANEL CUTOUT:


DIN 43 700: $138^{+1.0}_{-0}$ x $68^{+0.7}_{-0}$

FOR IP65: $136^{+0.5}_{-0}$ x $66.2^{+0.5}_{-0}$


Title **CERTIFIED CUSTOMER DRAWING for
SERIAL TEXT DISPLAY
BA488C IN PANEL MOUNTING ENCLOSURE**

Drawn RH	Checked	Scale NTS
Drawing No. Sheet 1 of 2		

Iss.	Date	Modification	Ckd.	Appd.
1				



BEKA
Hitchin
England
company confidential, copyright reserved.

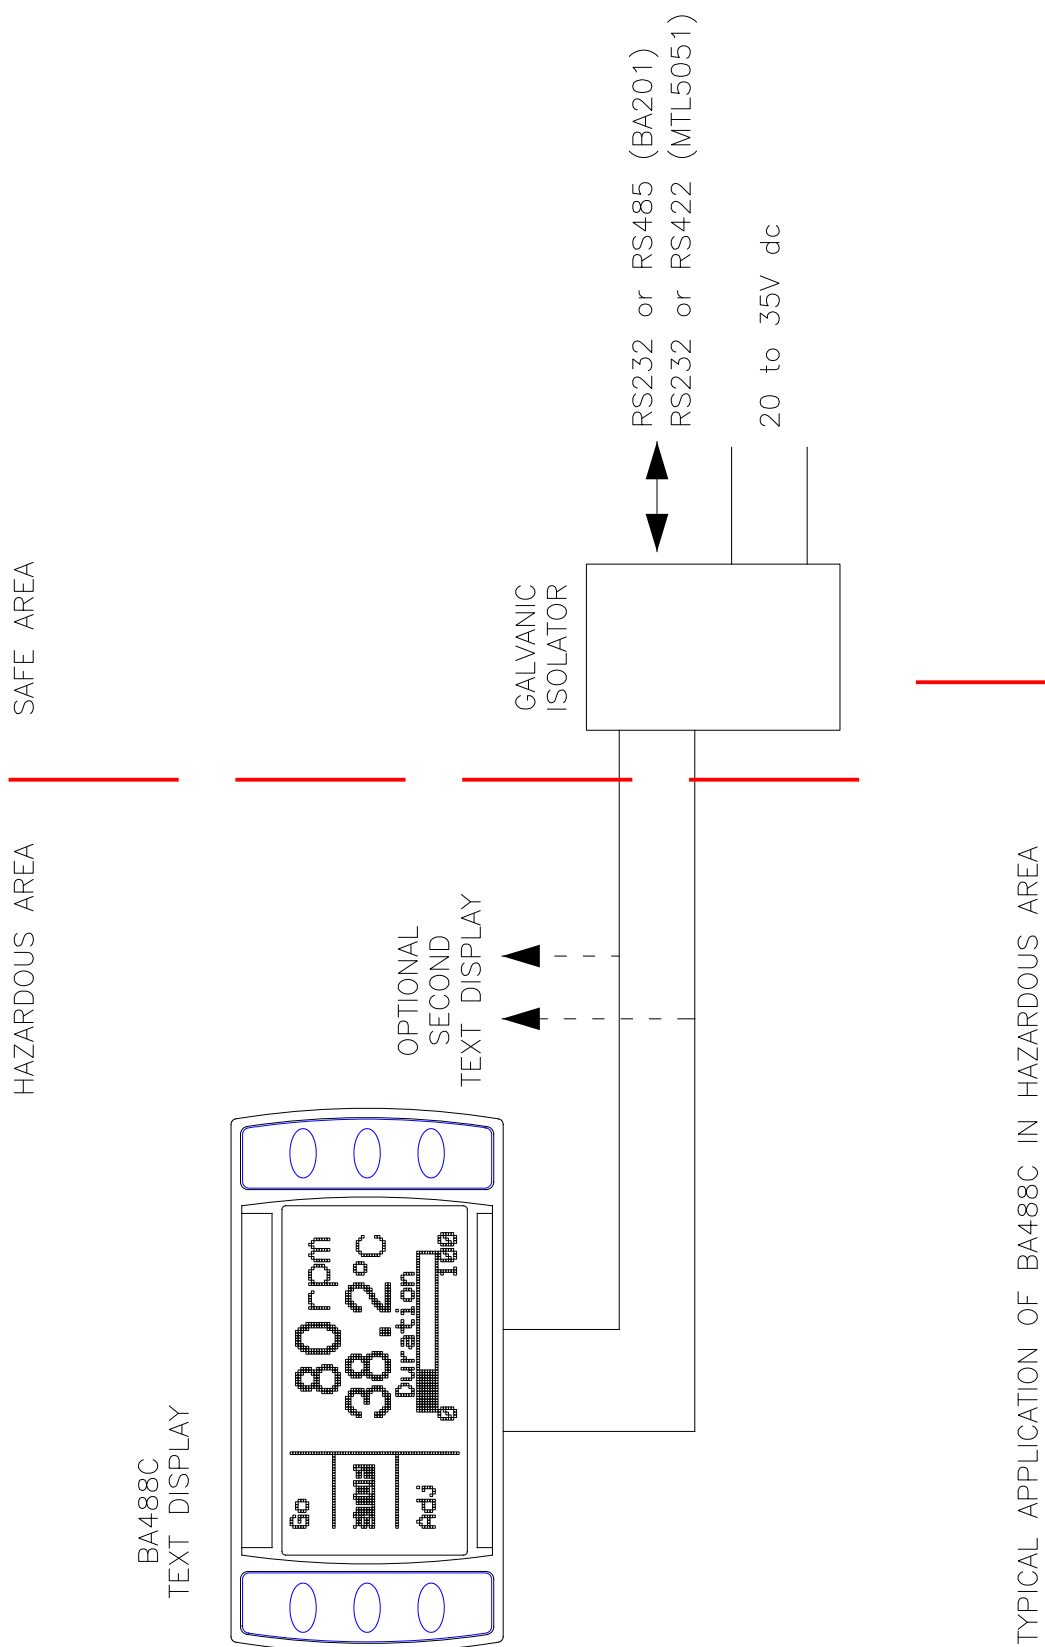

TYPICAL APPLICATION OF BA488C IN HAZARDOUS AREA

Title	CERTIFIED CUSTOMER DRAWING for SERIAL TEXT DISPLAY BA488C IN PANEL MOUNTING ENCLOSURE	Drawn	Checked	Scale
		RH		NTS
		Drawing No. Sheet 2 of 2		